

Brookline, MA
Hydrant Flow Tests

Project # 210801871

Location: 108 Centre St.

Date: Nov. 17, 2021

Time: 7:36 PM

Flow Hydrant: Williams St. @ Centre St.

End Time 7:38 PM

Gauge Hydrant: 108 Centre St., Brookline, MA

Duration 2

Nozzle Dia: 2.5 inches

Total Flow (gal) 2,511


	Static Pressure (psi)	Residual Pressure (psi)
Gauge Hydrant:	<u>84</u>	<u>80</u>
	<u> </u>	<u> </u>

Flow Hydrant:

Pitot Reading: 56 psi

Pitot Reading: 1256 gpm

Flow at 20 psi: 5612 gpm

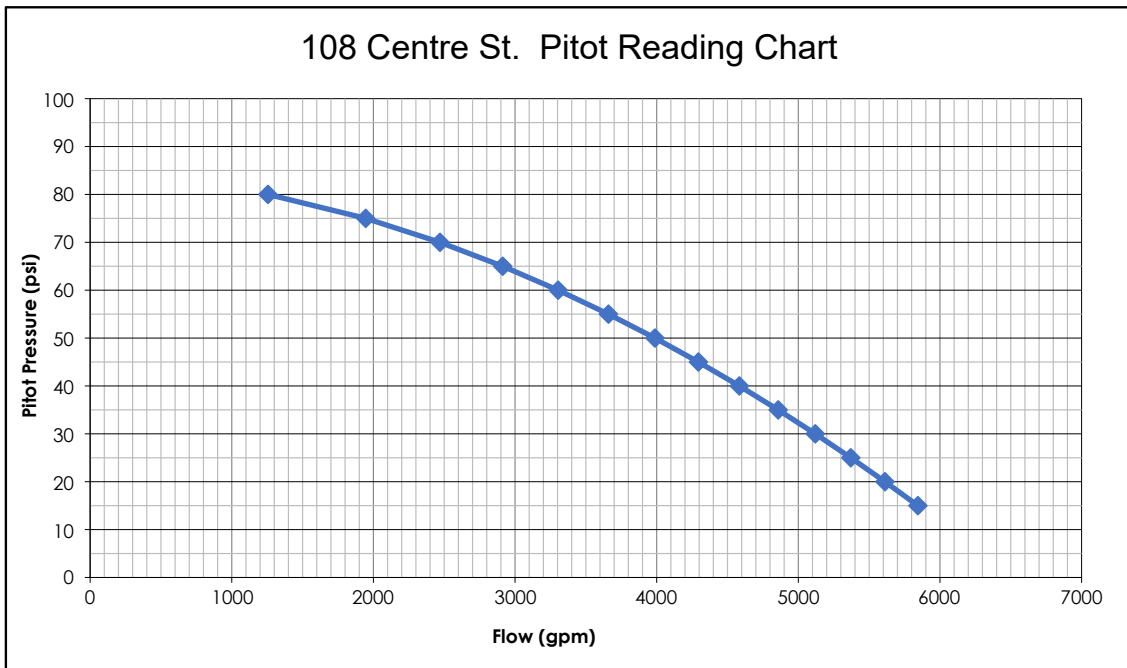

Note: 8" water main in Centre St.

Test By: J. Amato, A. Jones STANTEC.

Witnessed By: Brian, Mike, BWD

Stantec
Burlington, MA